

Containment Sampling Isolation Valve

MODEL F100-40 FOR NUCLEAR APPLICATIONS



Copes-Vulcan has been providing control valves and desuperheaters for the power, process since 1903 and been supplying nuclear valves for over 40 years. SPX provides a wide range of valves for the control of pressure, temperature and flow-induced noise in all types of power plants. Products include severe service and general service control valves, variable orifice desuperheaters, Raven™ trim and steam-conditioning valves and nuclear control valves, as well as custom designed specialty valves. Copes-Vulcan is recognized worldwide as a leader in valves for severe and critical service applications. Our strength lies in our ability to provide innovative valve solutions for our customers' application needs.

Finding innovative ways to help the world meet its ever growing demand for power is a key focus for SPX. SPX provides creative solutions that serve global energy markets in a myriad of ways. Our ideas are helping build more efficient power plants and renovate older existing facilities. SPX supplies a wide range of components - from air preheaters to filter systems for nuclear, coal-fired, combined cycle, solar, thermal and geothermal power plants.

With operations in over 35 countries, SPX has the global experience and regional presence, products and powerful ideas it takes to help our customers compete more effectively, and more efficiently deliver power to almost any part of the world.

Containment Sampling Isolation Valve

FEATURES

The Copes-Vulcan Model F100-40 valve can solve your leakage problems in critical applications by offering:

- Positive shutoff
- Reliable operation
- Radiation resistant materials
- Fast, easy maintenance
- No need for piping supports or restraints

3/8" (10MM) SAMPLING VALVE

The Copes-Vulcan F100-40 Sampling Valve was developed to provide positive shutoff and reliable operation for both sampling and containment isolation applications in nuclear power plants.


Such high-pressure water, steam and gas applications demand exceptional seat tightness. The Copes-Vulcan design incorporates a high-thrust actuator with thru-hardened trim components to ensure better than ANSI 70-2 Class V leakage at 2500 psid (17,225 kPa).

The valve was designed, built and tested in accordance with ASME Boiler and Pressure Vessel Code Section III for Classes 1, 2 or 3. ANSI B16.34 valves are also available. A maximum design pressure and temperature rating of 2500 psig (17,225 kPag) at 680°F (360°C) is standard.

Materials of construction were chosen for borate water service. These same materials are excellent choices for service water, steam and hydrogen media. Stainless steel is used for body, seat, plug/stem, actuator frame, frame-to-body mounting components and packing gland. The absence of hardfacing limits cobalt to minor residual elements.

The use of inert and radiation-resistant materials reduces maintenance and the risk of failure. The only non-metallic component used on the valve assembly that could experience degradation from exposure to radiation is the diaphragm. Copes-Vulcan has qualified the EPDM diaphragm material to 20 years service at 2.0×10^7 rads.

Typical product applications

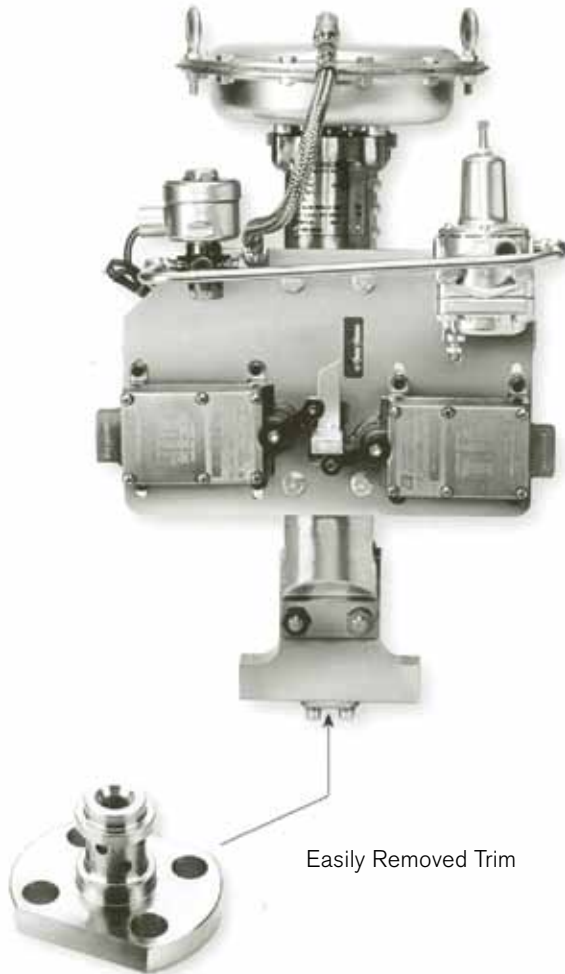

Piping supports and restraints are eliminated by the convenient actuator wall-mounting of the entire valve. This design allows groups of valves to be bank or gang-mounted.

Maintenance time and costs are also greatly reduced by the trim and packing gland arrangements. While the actuator may be removed from the valve when necessary, there is no need to do so when repacking or changing the trim. Ease of trim removal and a minimum of components involved (plug/stem, seat, packing and two seals) allow maintenance personnel to get the job done fast, which is especially important during short outages or when working in hot areas of the plant. Packing life is extended by backseat, double-packed stuffing box and leak-off features.

Nuclear Power

Sampling/Containment Isolation Valves
Steam Generator Sample Isolation
Feedwater Test Circuit Isolation



DESIGN EVALUATION TESTING

Over 45,000 hot cycles and this containment sampling/isolation valve still exceeds leakage requirements.

Purpose

The testing at our plant was designed to evaluate the performance of the Copes-Vulcan 3/8" (vvzv) Sampling/Isolation Valve while operating under expected service conditions as simulated by the Copes-Vulcan hot test loop.

Description

The valve was cycle tested in a pressurized water hot flow loop.

Conclusion

The valve performed successfully in all phases of operation, including 45,500 hot cycles with no loss of structural integrity.

PRELIMINARY TESTING

A baseline of satisfactory operation was established during preliminary testing at ambient temperature:

Fluid Boundary Integrity

Hydrostatic testing at 5825 psig (40,135 kPag).

Mainseat Leakage

Zero leakage obtained at 2500 psi differential (17225 kPa differential), thus exceeding the requirements of FCI 70-2/ANSI Class V.

Cycling

100 cycles with 2500 psi differential (17,225 kPa differential) closed and 500 psi differential (3445 kPa differential), minimum, open.

Stroke times:

Closing — .4 seconds

Opening — .4 seconds

HOT TESTING

A testing model was configured with 630°F (332°C) water at 2500 psig (17,225 kPag).

Hot Cycles

45,500 cycles were successfully performed. 26,800 hot cycles were conducted with 2500 psi differential (17,225 kPa differential) in closed position, and a minimum of 500 psi differential (3445 kPa differential) in open position. The remainder of the cycles were conducted at system pressure. Stroke times of .4 second closed and .4 second open were typical throughout.





Hot Mainseat Leakage

The mainseat leakage was measured frequently during cycling (every 1000 cycles minimum) and exceeded the FCI 70-2/ANSI Class V requirements throughout.

Specifications

MATERIALS	
BODY	ASME-SA182, Grade F316
SEAT	ASME-SA479, Type 410
PLUG/STEM	ASTM-A276, Type 420
FRAME	ASTM-A351, Grade CF8M
FEATURES	
END CONNECTIONS	Socket weld to accept 3/8" (10mm) O.D. tubing
ANSI PRESSURE CLASS	Special Intermediate Class 1550
ACTUATOR	Fail closed or fail open
SEATING THRUST	960 lb (4270 N) fail closed
	1600 lb (3230 N) fail open
ACCESSORIES	Filter Regulator
SEISMIC QUALIFICATION	2g vertical, 3g horizontal
OPTIONS	
LEAK-OFF	1/4" (8mm) tapped and plug
ACCESSORIES	(2) limit switches and solenoid (IEEE-qualified where required)
END EXTENSIONS	3/8" (10mm) stainless steel tubing factory-welded to meet existing end-to-end connections and allow instant installation between compression fitting, 3/4" (20mm) socket adaptors, etc.

**1.50" Clearance Required
40mm for Reverse Action**

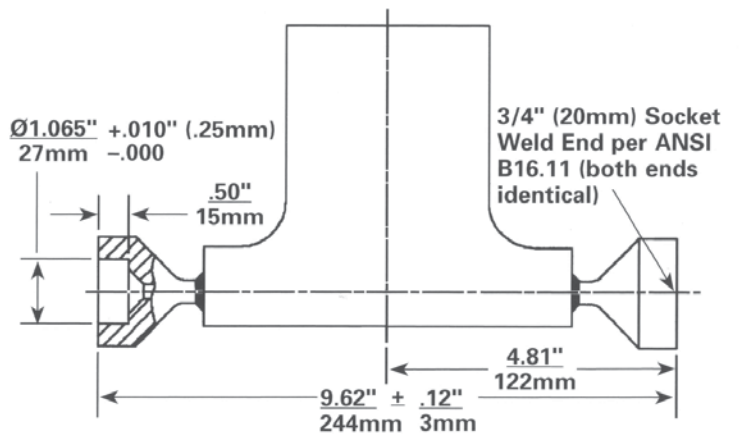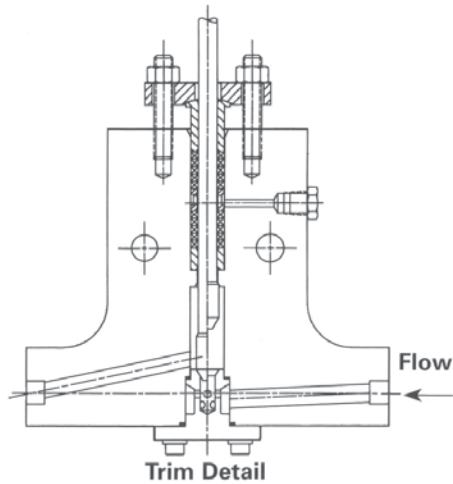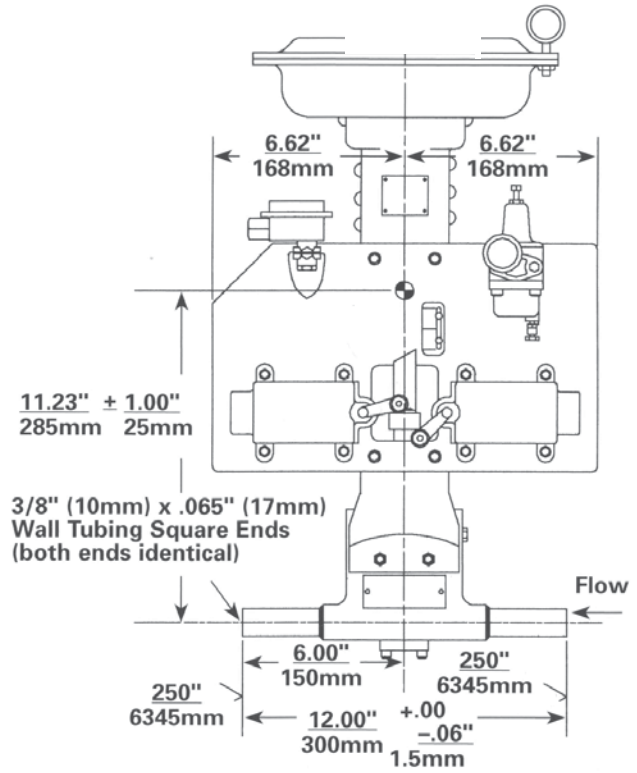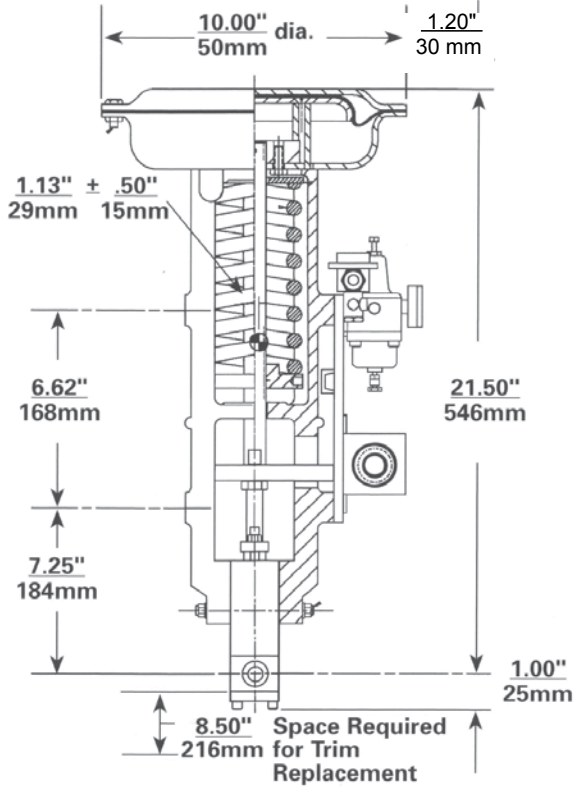

Containment Sampling Isolation Valve

**MODEL F100-40 FOR
NUCLEAR APPLICATIONS**



Global locations

SPX FLOW TECHNOLOGY

5620 West Road
McKean, PA 16426
United States of America
+1 814 476 5800

SPX FLOW TECHNOLOGY

Road Two, Industrial Estate
Winsford, Cheshire CW7 3QL
England
+44 1606 552041

SPX FLOW TECHNOLOGY

25 International Business Park
#03-03/12 German Centre
Singapore 609916
+65 6264 4366

SPX FLOW TECHNOLOGY

6F Treasury Building
1568 Hua Shan Road
Shanghai 200052
PR China
+86 21 2208 5888

Based in Charlotte, North Carolina, SPX Corporation (NYSE: SPW) is a global Fortune 500 multi-industry manufacturing leader. For more information, please visit www.spx.com

SPX FLOW TECHNOLOGY

5620 West Rd.
McKean, PA 16426
P: (814) 476-5800
F: (814) 476-5854
E: cv@spx.com

SPX reserves the right to incorporate our latest design and material changes without notice or obligation.

Design features, materials of construction and dimensional data, as described in this bulletin, are provided for your information only and should not be relied upon unless confirmed in writing. Please contact your local sales representative for product availability in your region. For more information visit www.spx.com.

The green ">" is a trademark of SPX Corporation, Inc.

ISSUED 03/2013 CV-144-US

COPYRIGHT © 2013 SPX Corporation